

## Fire Prevention Division

### *Fire Apparatus Access Driveway Turnarounds and Turnouts*


#### *Single Residential Lot*

- Fire apparatus access driveways shall have an approved, all weather driving surface, capable of supporting the imposed load of fire apparatus.
- Driveways shall be located within 150 feet of the furthest portion of the exterior of each structure.
- Dead-end driveways in excess of 150 feet in length shall be provided with emergency vehicle turnarounds.
- Driveways in excess of 250 feet in length and less than 20 feet in width **may require** turnouts in addition to turnarounds.
- Emergency Vehicle Turnarounds shall remain vacant at all times


*The following is a list of distance, width, and height requirements related to residential driveway emergency vehicle turnarounds and turnouts:*

- The minimum unobstructed vertical clearance shall be 13 feet 6 inches
- The maximum slope of the turnaround shall not exceed 10% in grade.
- The minimum driveway width shall not be less than 14 feet.
- The maximum slope of the driveway shall not exceed 15% in grade.


## Emergency Vehicle Turnarounds

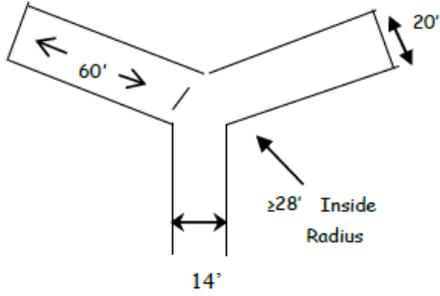


Driveway Y Turn



Driveway Cul-de-sac




Driveway Alternative Hammerhead

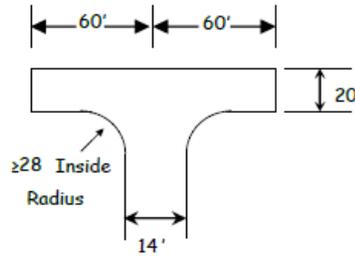

Driveway Hammerhead

## Turnout

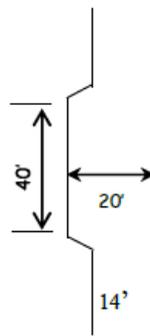

Driveway Turnout Requirement